

# Canadiana Shores Drinking Water System

---

Waterworks # 220006491  
System Category – Large Municipal Residential

## Annual Water Report

Prepared For: The City of Kawartha Lakes

Reporting Period of January 1<sup>st</sup> – December 31<sup>st</sup>, 2023

Issued: February 21, 2024

Revision: 0

Operating Authorities:



**OCWA**



This report has been prepared to satisfy the annual reporting requirements in O. Reg. 170/03 Section 11 and Schedule 22

## Table of Contents

Annual Water Report .....	1
Report Availability .....	1
Compliance Report Card .....	1
System Process Description .....	1
Raw Source .....	1
Treatment .....	1
Treatment Chemicals used during the reporting year .....	2
Summary of Non-Compliance.....	2
Adverse Water Quality Incidents.....	2
Non-Compliance.....	2
Non-Compliance Identified in a Ministry Inspection .....	2
Flows .....	2
Raw Water Flows.....	2
Well #2 Total Monthly Flows .....	3
Well #2 Monthly Rated Flows .....	3
Well #3 Total Monthly Flows .....	4
Well #3 Monthly Rated Flows .....	4
Well #4 Total Monthly Flow.....	5
Well #4 Monthly Rated Flows .....	5
Treated Water Flows .....	6
Treated Water Monthly Flows – Rated Capacity .....	6
Annual Total Treated Water Flow Comparison.....	6
Regulatory Sample Results Summary .....	7
Microbiological Testing .....	7
Operational Testing .....	7
Inorganic Parameters .....	7
Schedule 15 Sampling.....	9
Organic Parameters.....	9
Additional Legislated Samples.....	10
Major Maintenance Summary.....	12
WTRS Submission Confirmation .....	A

## Report Availability

This system does not serve more than 10,000 residences. The annual reports will be available to residents at the City of Kawartha Lakes Public Works Administration Office and on the City’s website at [www.kawarthalakes.ca](http://www.kawarthalakes.ca). Notification that reports are available free of charge will be made on the City of Kawartha Lakes website. The City of Kawartha Lakes Public Works Administration Office is located at 322 Kent Street West in Lindsay, Ontario.

## Compliance Report Card

**Drinking Water System Number:** 220006491

**Drinking Water System Name:** Canadiana Shores DWS

**Drinking Water System Owner:** City of Kawartha Lakes

**Drinking Water System Category:** Large Municipal Residential

**Period Being Reported:** January 1, 2023 - December 31, 2023

	# of Events	Date	Details
<b>Health &amp; Safety</b>			
Number of Incidents	0		
<b>Drinking Water</b>			
MECP Inspections	1	July 18, 2023	Unannounced - Detailed Drinking Water Inspection - Final Inspection Rating: 100%
AWQI's	0		
Number of Non-Compliances identified during the MECP Inspection	0		
Number of Boil Water Advisories	0		

## System Process Description

### Raw Source

The water supply for the DWS comes from three (3) groundwater wells that are considered to be GUDI (Groundwater Under the Direct Influence of Surface Water).

### Treatment

The treatment system consists of the following:

- sodium hypochlorite disinfection system
- two (2) package treatment units with backwash equipment and backwash waste storage/decant tank system
- two (2) cartridge filtration systems

- two (2) booster pumps and equalization tank system
- hydropneumatic tanks
- a high lift pumping system
- Stand-by diesel generator on-site

Treatment Chemicals used during the reporting year:

Chemical Name	Use	Supplier
Sodium Hypochlorite	Disinfection	Jutzi Water Technologies

## Summary of Non-Compliance

### Adverse Water Quality Incidents

There were no adverse water quality incidents reported during the reporting period.

### Non-Compliance

There were no adverse water quality incidents reported during the reporting period.

### Non-Compliance Identified during Ministry Inspection

There were no non-compliances identified in a Ministry Inspection during this period.

## Flows


The Canadiana Shores Drinking Water System is operating on average under half the rated capacity.

### Raw Water Flows

The Raw Water flows are regulated under the Permit to Take Water. 2023 Raw Flow Data was submitted to the Ministry electronically under permit #1311-BMZH78. A copy of the confirmation is included in Appendix A. The Permit to Take Water compliance criteria is in litres per minute (L/min) but for the purposes of this report the flow rate is reported in litres per second (L/sec) based on industry standard for flow monitoring recording.


Total Monthly Flows (m<sup>3</sup>/d)

Max Allowable PTTW – Well #2

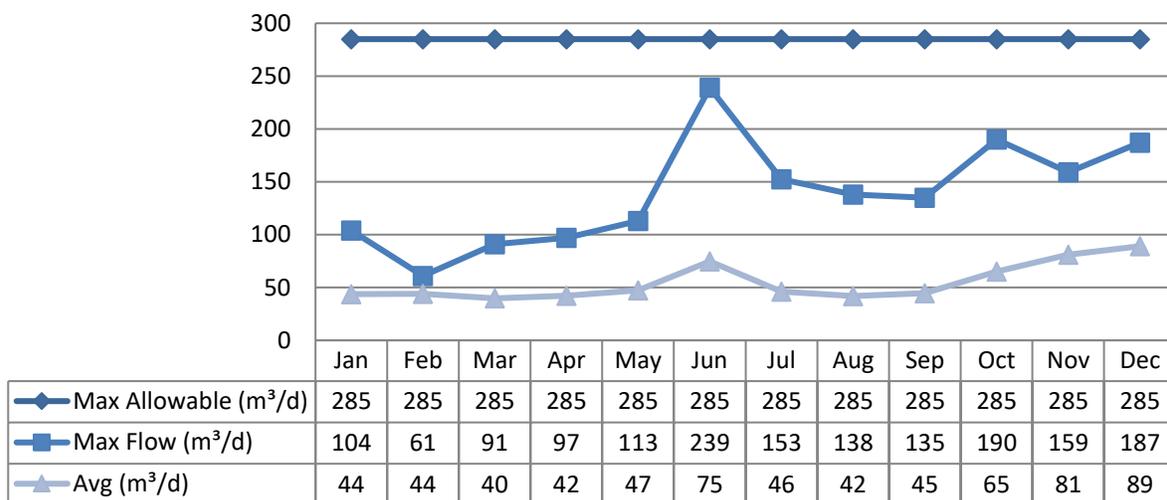

Monthly Rated Flows (L/s)


Max allowable rate – PTTW – Well #2

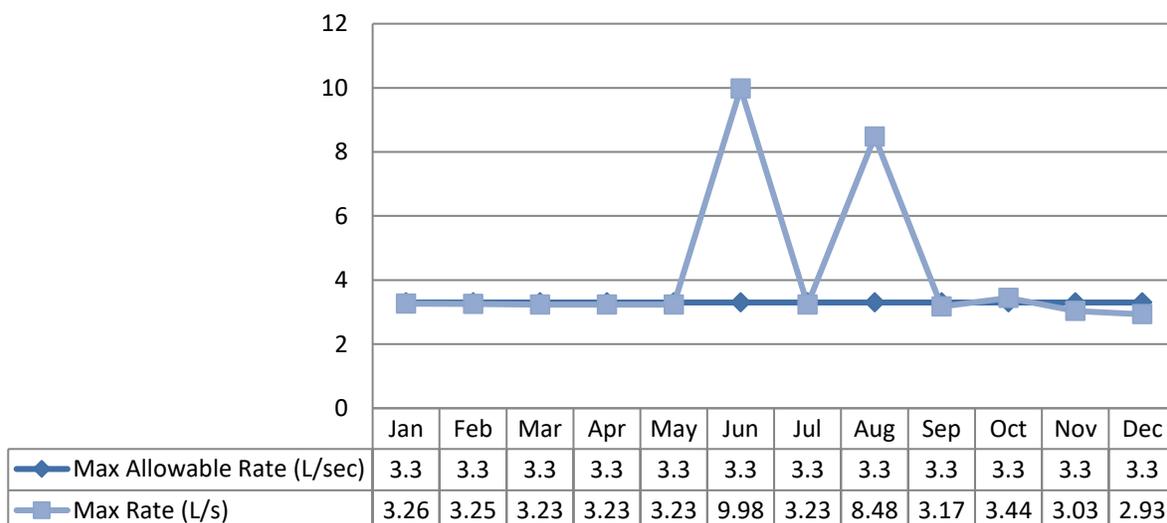

**Note:** Certain operational circumstances could cause results to be temporarily outside of the allowable rates. In June 2023, the allowable rate was momentarily surpassed as a result of annual calibration of the flow meter and did not indicate a true exceedance. In August 2023, the allowable rate was momentarily surpassed as a result of a power outage and did not indicate a true exceedance. A true exceedance would be documented within this report.


Total Monthly Flows (m<sup>3</sup>/d)

Max Allowable PTTW – Well #3

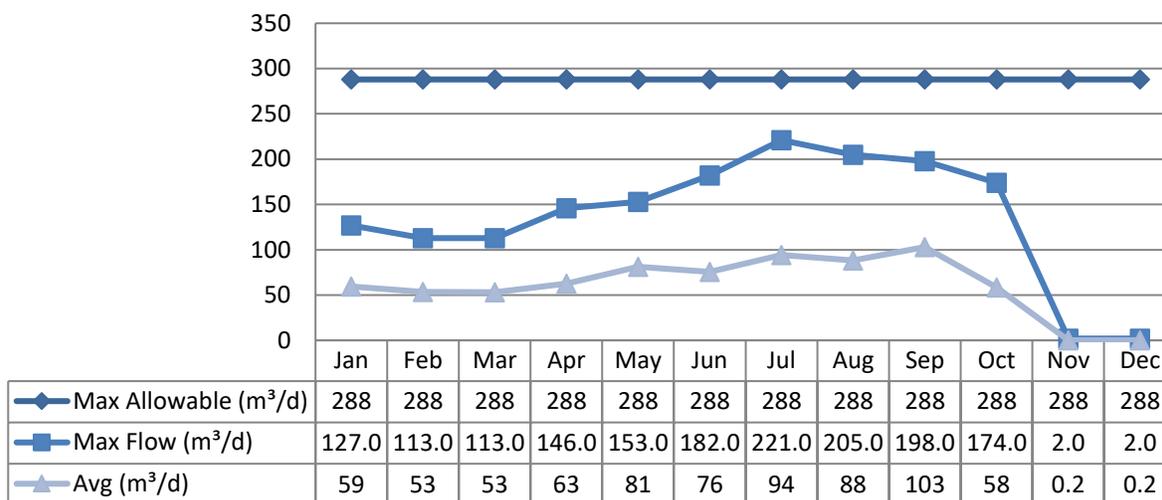

Monthly Rated Flows (L/s)


Max allowable rate – PTTW – Well #3

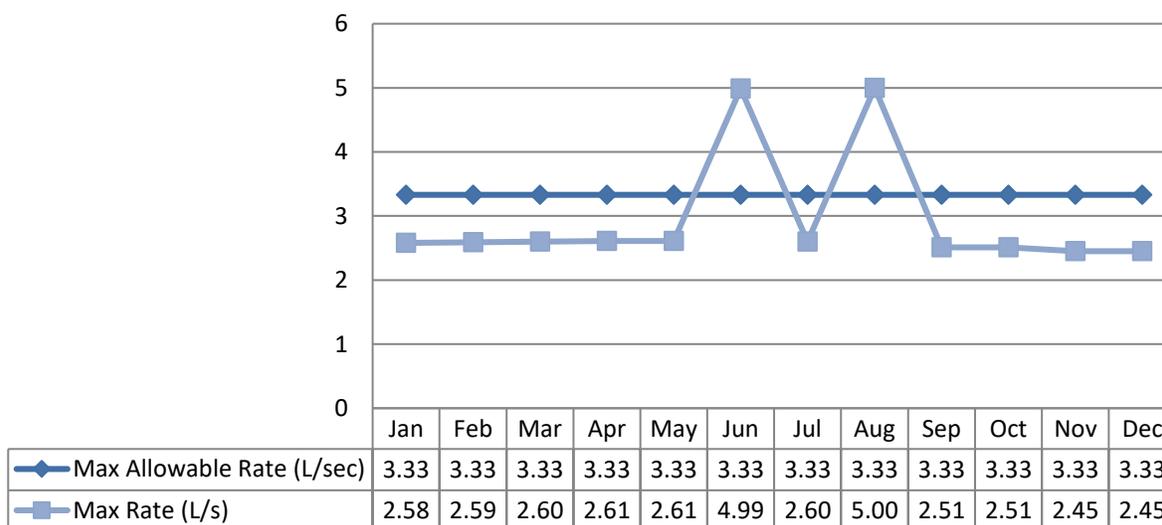

**Note:** Certain operational circumstances could cause results to be temporarily outside of the allowable rates. In June 2023, the allowable rate was momentarily surpassed as a result of annual calibration of the flow meter and did not indicate a true exceedance. In August 2023, the allowable rate was momentarily surpassed as a result of a power outage and did not indicate a true exceedance. A true exceedance would be documented within this report.


Monthly Rated Flows (L/s)

Max allowable rate – PTTW – Well #4

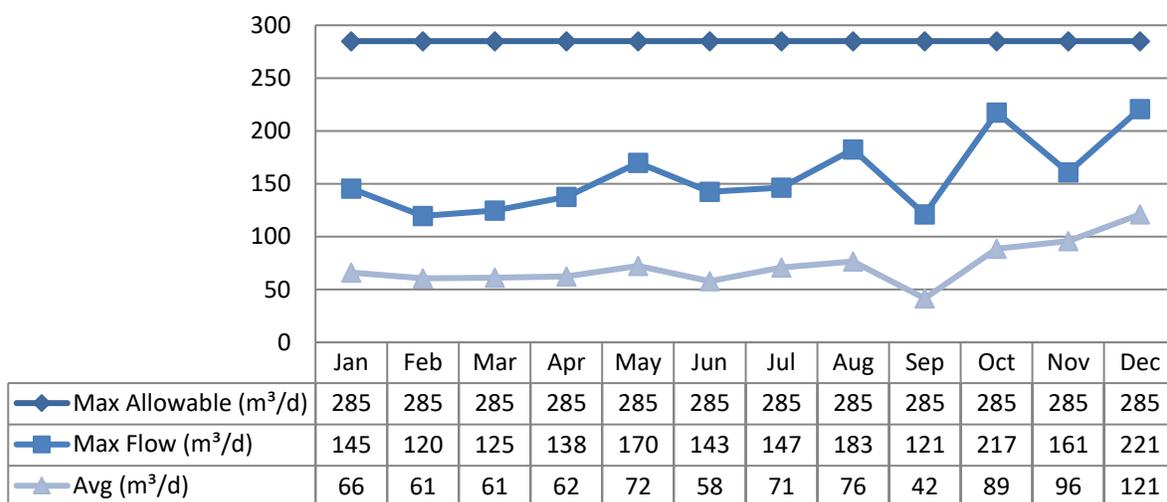

Monthly Rated Flows (L/s)

Max allowable rate – PTTW – Well #4

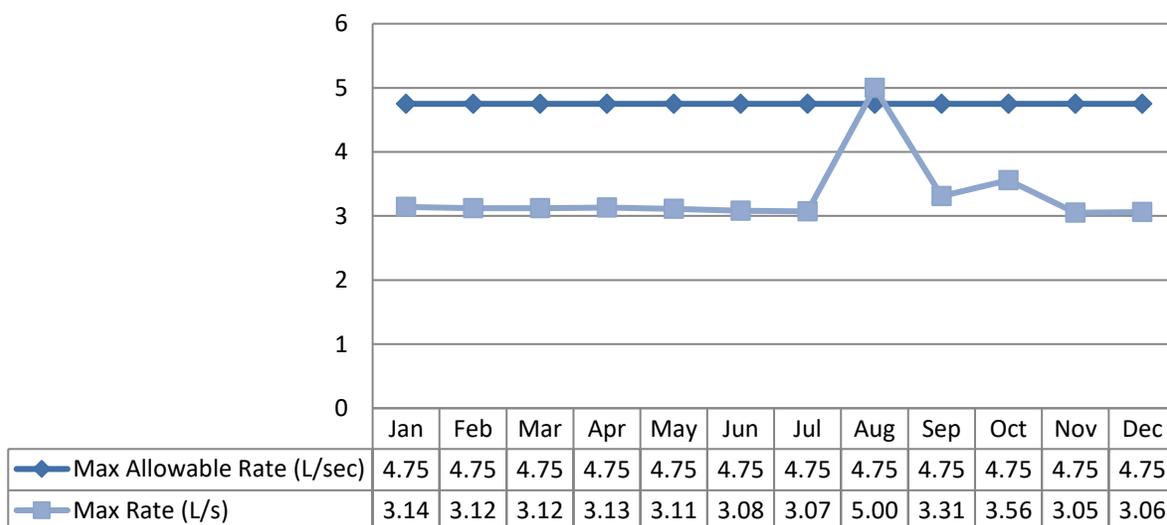


**Note:** Certain operational circumstances could cause results to be temporarily outside of the allowable rates. In August 2023, the allowable rate was momentarily surpassed as a result of a power outage and did not indicate a true exceedance. A true exceedance would be documented within this report.

### Treated Water Flows

The Treated Water flows are regulated under Municipal Drinking Water Licence #141-112.


#### Monthly Rated Flows

Rated Capacity – MDWL

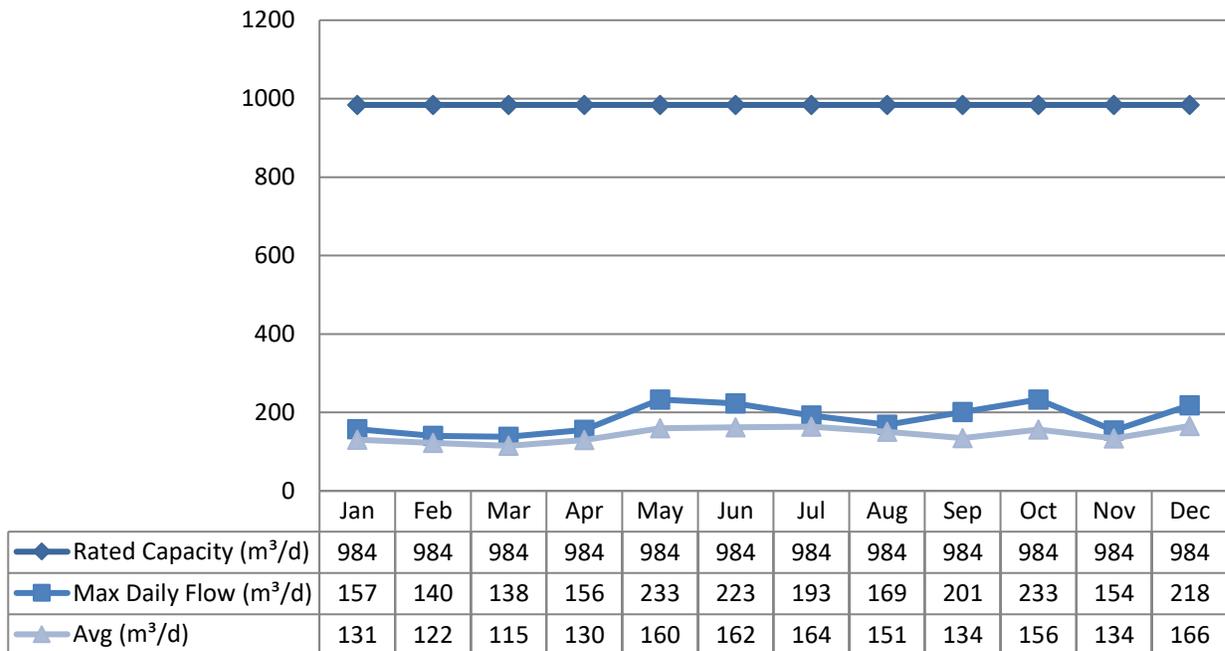

#### Annual Total Flow Comparison

Total Annual m<sup>3</sup>

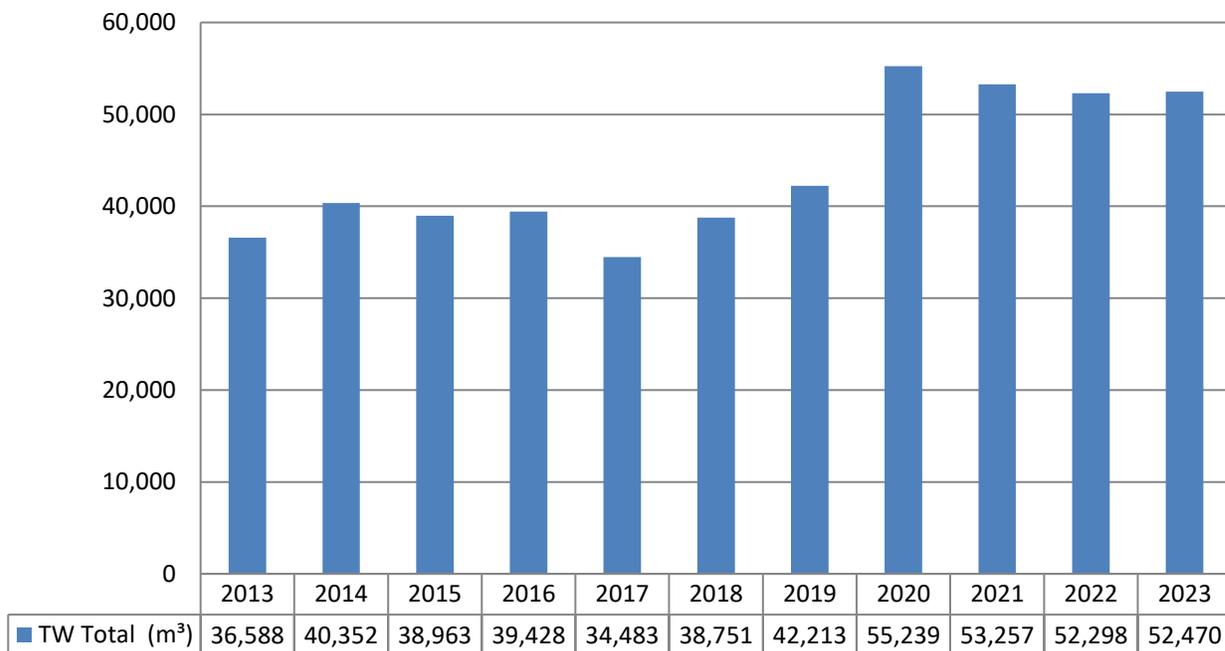

## Regulatory Sample Results Summary

### Microbiological Testing

(completed under Schedule 10, 11 or 12 of Ontario Regulation 170/03, during the reporting period).

	No. of Samples Collected	Range of E.Coli Results	Range of E.Coli Results	Range of Total Coliform Results	Range of Total Coliform Results	Range of HPC Results	Range of HPC Results
		Min	Max	Min	Max	Min	Max
Raw Well 2	52	0	2	0	2		
Raw Well 3	55	0	0	0	1		
Raw Well 4	53	0	0	0	5		
Treated	54	0	0	0	0	0	13
Distribution	156	0	0	0	0	0	26

### Operational Testing

(completed under Schedule 7, 8 or 9 of Ontario Regulation 170/03, during the reporting period).

	No. of Samples Collected	Range of Results Minimum	Range of Results Maximum
Turbidity Well 2 (NTU)	12	0.09	0.55
Turbidity Well 3 (NTU)	12	0.10	0.82
Turbidity Well 4 (NTU)	12	0.16	0.65
Turbidity – Filter Line 1 (NTU)	8760	0	1.06
Turbidity – Filter Line 2 (NTU)	8760	0	1.99
Chlorine - TW	8760	1.36	3.23
Fluoride (If the DWS provides fluoridation)	N/A	N/A	N/A

**Note:** Record the unit of measure if it is **not** milligrams per litre.

**Note:** For continuous monitors 8760 is used as the number of samples. Spikes recorded by on-line instrumentation were a result of air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg. 170/03. A true exceedance would be documented within this report.

### Inorganic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. Sodium and Fluoride are required to be tested every 5 years. Nitrate and Nitrite are tested quarterly and the metals are tested annually as required under O. Reg. 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O. Reg. 169/03
- MDL = Method Detection Limit

Treated Water Parameter	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances MAC	Exceedances ½ MAC
Antimony: Sb (ug/L) - TW	2023/01/03	<MDL 0.6	6.0	No	No
Arsenic: As (ug/L) - TW	2023/01/03	<MDL 0.2	10.0	No	No
Barium: Ba (ug/L) - TW	2023/01/03	132.0	1000.0	No	No
Boron: B (ug/L) - TW	2023/01/03	12.0	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2023/01/03	0.003	5.0	No	No
Chromium: Cr (ug/L) - TW	2023/01/03	<MDL 0.08	50.0	No	No
Mercury: Hg (ug/L) - TW	2023/01/03	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2023/01/03	<MDL 0.04	50.0	No	No
Uranium: U (ug/L) - TW	2023/01/03	5.17	20.0	No	No
<b>Additional Inorganics</b>					
Fluoride (mg/L) - TW	2023/01/03	0.08	1.5	No	No
Nitrite (mg/L) - TW	2023/01/03	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2023/04/03	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2023/07/04	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2023/10/03	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2023/01/03	0.73	10.0	No	No
Nitrate (mg/L) - TW	2023/04/03	0.73	10.0	No	No
Nitrate (mg/L) - TW	2023/07/04	0.602	10.0	No	No
Nitrate (mg/L) - TW	2023/10/03	0.961	10.0	No	No
Sodium: Na (mg/L) - TW	2023/01/03	16.7	20*	No	Yes

\*There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

**Schedule 15 Sampling**

The Schedule 15 Sampling is required under O. Reg. 170/03. This system is under reduced sampling. No plumbing samples were collected.

Distribution System	Number of Sampling Points	Number of Samples	Range of Results Minimum	Range of Results Maximum	MAC (ug/L)	Number of Exceedances
Alkalinity (mg/L)	2	4	279	289	N/A	N/A
pH	2	4	7.41	7.64	N/A	N/A
Lead (ug/l)	2	4	0.03	0.12	10	N/A

**Organic Parameters**

These parameters are tested as a requirement under O. Reg. 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

Treated Water Parameter	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance MAC	Exceedance ½ MAC
Alachlor (ug/L) - TW	2023/01/03	<MDL 0.02	5.00	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2023/01/03	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2023/01/03	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2023/01/03	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2023/01/03	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2023/01/03	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2023/01/03	<MDL 0.05	90.00	No	No
Carbofuran (ug/L) - TW	2023/01/03	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2023/01/03	<MDL 0.17	2.00	No	No
Chlorpyrifos (ug/L) - TW	2023/01/03	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2023/01/03	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2023/01/03	<MDL 0.2	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2023/01/03	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2023/01/03	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2023/01/03	<MDL 0.35	5.00	No	No
1,1-Dichloroethylene (ug/L) - TW	2023/01/03	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2023/01/03	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2023/01/03	<MDL 0.15	900.00	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2023/01/03	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2023/01/03	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2023/01/03	<MDL 0.06	20.00	No	No

Canadiana Shores Drinking Water System – 2023 Annual Water Reports

Treated Water Parameter	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance MAC	Exceedance ½ MAC
Diquat (ug/L) - TW	2023/01/03	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2023/01/03	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2023/01/03	<MDL 1.0	280.00	No	No
Malathion (ug/L) - TW	2023/01/03	<MDL 0.02	190.00	No	No
2-Methyl-4chlorophenoxyacetic Acid (MCPA) (ug/L)	2023/01/03	<MDL 0.12	100.00	No	No
Metolachlor (ug/L) - TW	2023/01/03	<MDL 0.01	50.00	No	No
Metribuzin (ug/L) - TW	2023/01/03	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2023/01/03	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2023/01/03	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2023/01/03	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2023/01/03	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2023/01/03	<MDL 0.01	2.00	No	No
Picloram (ug/L) – TW	2023/01/03	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2023/01/03	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2023/01/03	<MDL 0.01	10.00	No	No
Terbufos (ug/L) - TW	2023/01/03	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2023/01/03	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2023/01/03	<MDL 0.2	100.00	No	No
Triallate (ug/L) - TW	2023/01/03	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2023/01/03	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2023/01/03	<MDL 0.25	5.00	No	No
Trifluralin (ug/L) - TW	2023/01/03	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2023/01/03	<MDL 0.17	1.00	No	No
<b>Distribution Water</b>					
Trihalomethane: Total (ug/L) Annual Average - DW	2023	11.775	100	No	No
HAA Total (ug/L) Annual Average - DW	2023	5.3	80	No	No

MAC = Maximum Allowable Concentration as per O. Reg. 169/03

MDL = Method Detection Limit

**Additional Legislated Samples**

Date of legal instrument issued	Parameter	Date Sampled	Result	Unit of Measure
Sep. 21, 2021	Suspended Solids (Composite)	Jan. 30, 2023	3	mg/L

<b>Date of legal instrument issued</b>	<b>Parameter</b>	<b>Date Sampled</b>	<b>Result</b>	<b>Unit of Measure</b>
Sep. 21, 2021	Suspended Solids (Composite)	Feb. 27, 2023	2	mg/L
Sep. 21, 2021	Suspended Solids (Composite)	Mar. 27, 2023	<2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Apr. 24, 2023	<2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	May 29, 2023	2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Jun. 26, 2023	<2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Jul. 31, 2023	2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Aug. 28, 2023	4	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Sep. 25, 2023	<2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Oct. 30, 2023	2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Nov. 27, 2023	<2	mg/L
Apr. 21, 2023	Suspended Solids (Composite)	Dec. 27, 2023	7	mg/L
Apr. 21, 2023	Suspended Solids 12 month Rolling Average Concentration	2023	2.7	mg/L

**Note:** Suspended Solids Annual Average Concentration limit is 25 mg/L as per MDWL 141-112.

**Major Maintenance Summary incurred to install, repair or replace required equipment**

<b>WO #</b>	<b>Description</b>
3106109	Well abandonment (old), removal
3246885	Pump Cent 03 Highlift, Service/Rebuild
3246886	Pump Cent 04 Highlift, Rebuild/Service
3287777	Spare fuse, Replace bulbs (Power Distribution)
3338691	Toilet repair
3386088	Pump submersible HLP 5, Faulting
3387514	LOTO Wall mount, Install
3434590	Backwash pump faulting “over voltage VFD”
3435844	Disconnects in Filter Gallery, Replace
3524525	Pump submersible HLP 5, Faulting
3575382	Filter performance test
3625372	Heater propane, Motor, Replace
3625507	Filtration, Cartridge, Replace air vent
3706390	Power service, Repair

# Appendix A

## WTRS Submission Confirmations



Ministry of the Environment,  
Conservation and Parks

| [WT DATA](#) | [USER PROFILE](#) | [CONTACT US](#) | [HELP](#) | [HOME](#) | [LOGOUT](#) |

Location: [WTRS](#) / [WT DATA](#) / [Input WT Record](#) WTRS-WT-008

**Water Taking Data submitted successfully.**

**Confirmation:**


Thank you for submitting your water taking data online.

Permit Number: 1311-BMZH78  
Permit Holder: THE CORPORATION OF THE CITY OF KAWARTHA LAKES.  
Received on: Jan 24, 2024 10:41 AM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Print Confirmation](#)   [Return to Main Page](#)

CITY OF KAWARTHA LAKES | 2024/01/24  
version: v4.5.0.21 (build#: 22)  
Last modified: 2018/09/18

 This site maintained by  
the Government of Ontario ©2024 [Queen's Printer for Ontario](#)