

# Southview Estates Drinking Water System

---

Waterworks # 220012260  
System Category – Large Municipal Residential

## Annual Water Report

Prepared For: The City of Kawartha Lakes

Reporting Period of January 1<sup>st</sup> – December 31<sup>st</sup>, 2023

Issued: February 24, 2024

Revision: 0

Operating Authorities:



This report has been prepared to satisfy the annual reporting requirements in O. Reg. 170/03 Section 11 and Schedule 22

## Table of Contents

Annual Water Report .....	1
Report Availability .....	1
Compliance Report Card .....	1
System Process Description .....	1
Raw Source .....	1
Treatment .....	1
Treatment Chemicals used during the reporting year: .....	2
Summary of Non-Compliance.....	2
Adverse Water Quality Incidents.....	2
Non-Compliance .....	2
Non-Compliance Identified in a Ministry Inspection: .....	2
Flows .....	2
Raw Water Flows.....	2
Total Monthly Flows (m <sup>3</sup> /d)-Raw .....	3
Monthly Rated Flows (L/s)-Raw.....	3
Treated Water Flows .....	3
Monthly Rated Flows .....	4
Annual Total Flow Comparison.....	4
Regulatory Sample Results Summary .....	5
Microbiological Testing .....	5
Operational Testing .....	5
Inorganic Parameters .....	5
Schedule 15 Sampling:.....	6
Organic Parameters.....	7
Additional Legislated Samples.....	8
Major Maintenance Summary.....	9
WTRS Data and Submission Confirmation .....	A

## Report Availability

This system does not serve more than 10,000 residences. The annual reports will be available to residents at the City of Kawartha Lakes Public Works Administration Office and on the City’s website at: [www.kawarthalakes.ca](http://www.kawarthalakes.ca). Notification that reports are available free of charge will be made on the City of Kawartha Lakes website. The City of Kawartha Lakes Public Works Administration Office is located at 322 Kent Street West in Lindsay, Ontario.

## Compliance Report Card

**Drinking Water System Number:** 220012260

**Drinking Water System Name:** Southview Estates DWS

**Drinking Water System Owner:** City of Kawartha Lakes

**Drinking Water System Category:** Large Municipal Residential

**Period Being Reported:** January 1, 2023 - December 31, 2023

	# of Events	Date	Details
<b>Health &amp; Safety</b>			
Number of Incidents	0		
<b>Drinking Water</b>			
MECP Inspections	1	December 13, 2023	Unannounced Detailed Drinking Water Inspection. Final inspection rating was 100%.
AWQI's	0		
Number of Non-Compliances	0		
Number of Boil Water Advisories	0		

## System Process Description

### Raw Source

The Southview Estates Drinking Water System is supplied with surface water from Sturgeon Lake.

### Treatment

The treatment system consists of the following:

- Dual train conventional filtration package plant
- Inline static mixer
- Coagulant feed system with addition of SternPAC
- Coagulant aid feed system with addition of polymer

- Two mono-media upflow clarifier units
- Two dual media rapid gravity filters
- Sodium hypochlorite feed system for primary disinfection
- Dual celled chlorine contact tanks (274 m<sup>3</sup>) located beneath the plant
- Two highlift pump chambers housing five pumps; three highlift and two backwash
- Sodium hypochlorite feed system for post chlorination
- Online analyzers to monitor both free treated chlorine and filter effluent turbidity
- Wastewater treatment system that consists of two backwash pumps and two settling tanks that receive backwash water and clarifier sludge
- SCADA computer control system
- Zebra mussel control system
- Standby power generator

Treatment Chemicals used during the reporting year:

Chemical Name	Use	Supplier
Sodium Hypochlorite	Disinfection	Jutzi
SternPAC	Coagulant	Kemira
Magnafloc	Coagulant Aid	BASF

## Summary of Non-Compliance

### Adverse Water Quality Incidents

There were no adverse water quality incidents reported during the reporting period.

### Non-Compliance

There were no non-compliance incidents during this period.

### Non-Compliance Identified in a Ministry Inspection:

There were no non-compliances identified in a Ministry Inspection for 2023/2024 inspection report.

## Flows


The Southview Estates Drinking Water System is operating under half the rated capacity.

### Raw Water Flows

The Raw Water flows are regulated under the Permit to Take Water.2023 Raw Flow Data was submitted to the Ministry electronically under permit #8118-AW2NZT. The confirmation and a copy of the data that was submitted are attached in Appendix A.


Total Monthly Flows (m<sup>3</sup>/d)

Max Allowable PTTW- Raw

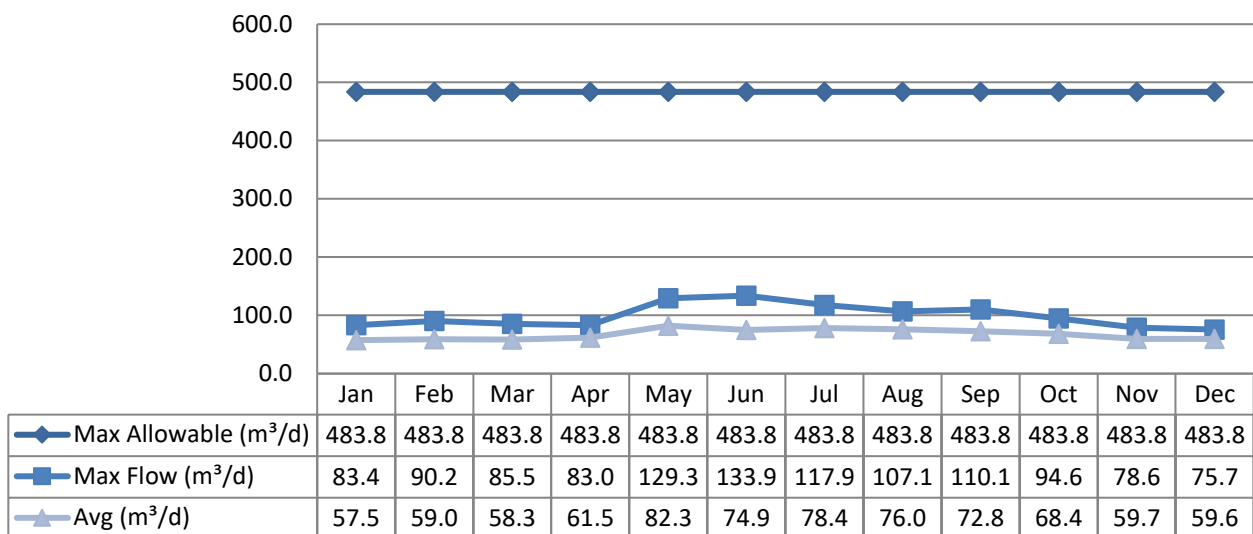

Monthly Rated Flows (L/s)

Max allowable rate – PTTW- Raw

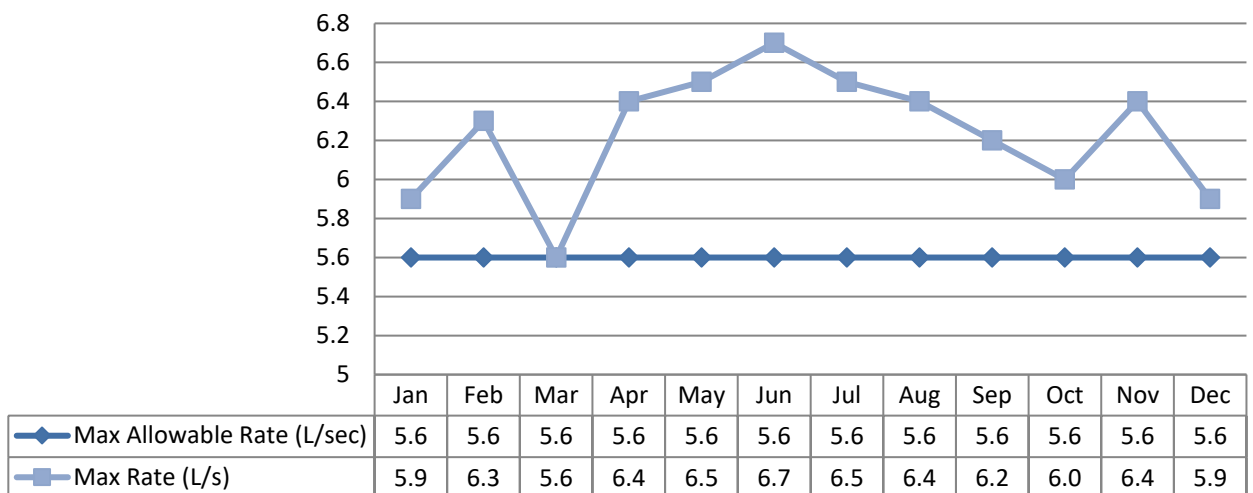


**Note:** The above table shows there were exceedances in instantaneous peak flow rate (L/s), exceedances were short in duration and reviewed for compliance. The scheduled Flow Meter calibration was in August 2023.

Treated Water Flows

The Treated Water flows are regulated under the Municipal Drinking Water Licence (MDWL) 141-101.


**Monthly Rated Flows**

Rated Capacity - MDWL

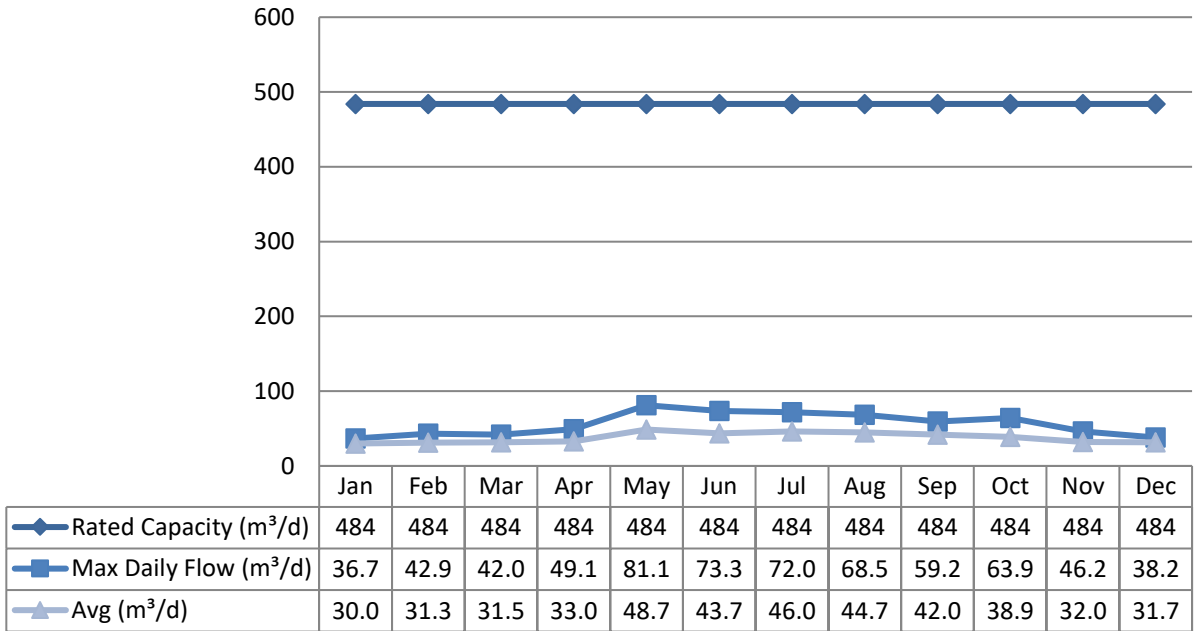

**Annual Total Flow Comparison**

Total Annual m³

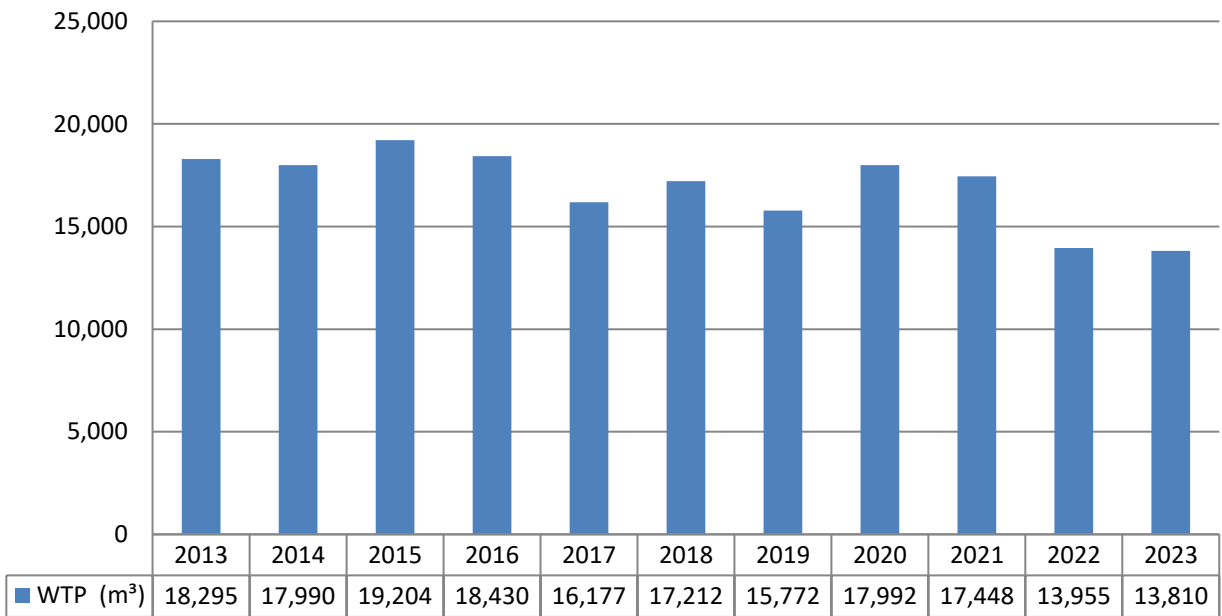

## Regulatory Sample Results Summary

### Microbiological Testing

	No. of Samples Collected	Range of E. Coli Results	Range of E. Coli Results	Range of Total Coliform Results	Range of Total Coliform Results	Range of HPC Results	Range of HPC Results
		Min	Max	Min	Max	Min	Max
<b>Raw</b>	52	0	NDOGT	0	NDOGT		
<b>Treated</b>	56	0	0	0	0	0	2
<b>Distribution</b>	156	0	0	0	0	0	3

**Note:** NDOGT - No Data, Overgrown with Target bacteria. Maximum counted Raw E.coli 3 Colony Forming Unit (CFU), maximum counted Raw Total Coliform 36 CFU

### Operational Testing

Parameter	Number of Samples Collected	Range of Results Minimum	Range of Results Maximum
<b>Turbidity Raw (NTU)</b>	51	0.59	2.38
<b>Turbidity Filter 1 (NTU)</b>	8760	0	2.00
<b>Turbidity Filter 2 (NTU)</b>	8760	0.03	2.00
<b>Chlorine</b>	8760	0.83	3.41
<b>Fluoride (If the DWS provides fluoridation)</b>	N/A	N/A	N/A

**Note:** Record the unit of measure if it is **not** milligrams per litre.

**Note:** For continuous monitors 8760 is used as the number of samples. Spikes recorded by on-line instrumentation were a result of air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg. 170/03

### Inorganic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. Sodium and Fluoride are required to be tested every 5 years. Nitrate and Nitrite are tested quarterly and the metals are tested annually as required under O. Reg. 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O. Reg. 169/03
- MDL = Method Detection Limit

Treated Water Parameter	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance MAC	Exceedance ½ MAC
Antimony: Sb (ug/L)	2023/01/03	<MDL 0.6	6.0	No	No
Arsenic: As (ug/L)	2023/01/03	<MDL	10.0	No	No

Treated Water Parameter	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance MAC	Exceedance ½ MAC
		0.2			
Barium: Ba (ug/L)	2023/01/03	22.1	1000.0	No	No
Boron: B (ug/L)	2023/01/03	12.0	5000.0	No	No
Cadmium: Cd (ug/L)	2023/01/03	0.011	5.0	No	No
Chromium: Cr (ug/L)	2023/01/03	0.43	50.0	No	No
Mercury: Hg (ug/L)	2023/01/03	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L)	2023/01/03	0.22	50.0	No	No
Uranium: U (ug/L)	2023/01/03	0.009	20.0	No	No
<b>Additional Inorganics</b>					
Fluoride (mg/L)	2023/01/03	<MDL 0.06	1.5	No	No
Nitrite (mg/L)	2023/01/03	<MDL 0.003	1.0	No	No
Nitrite (mg/L)	2023/04/03	<MDL 0.003	1.0	No	No
Nitrite (mg/L)	2023/07/06	<MDL 0.003	1.0	No	No
Nitrite (mg/L)	2023/10/03	<MDL 0.003	1.0	No	No
Nitrate (mg/L)	2023/01/03	0.358	10.0	No	No
Nitrate (mg/L)	2023/04/03	0.378	10.0	No	No
Nitrate (mg/L)	2023/07/06	0.156	10.0	No	No
Nitrate (mg/L)	2023/10/03	0.055	10.0	No	No
Sodium: Na (mg/L)	2023/01/03	13.8	20*	No	Yes

\*There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

**Schedule 15 Sampling:**

The Schedule 15 Sampling is required under O. Reg. 170/03. This system is under reduced sampling. No plumbing samples were collected.

Distribution System	Number of Sampling Points	Number of Samples	Range of Results Minimum	Range of Results Maximum	MAC (ug/L)	Number of Exceedances
Alkalinity (mg/L)	2	2	63	84	N/A	N/A
pH	2	2	7.42	7.67	N/A	N/A
Lead (ug/l)	2	2	0.10	0.15	10	0



### Organic Parameters

These parameters are tested annually as a requirement under O. Reg. 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

Treated Water Parameter	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance MAC	Exceedance ½ MAC
Alachlor (ug/L)	2023/01/03	<MDL 0.02	5.0	No	No
Atrazine + N-dealkylated metabolites (ug/L)	2023/01/03	<MDL 0.01	5.0	No	No
Azinphos-methyl (ug/L)	2023/01/03	<MDL 0.05	20.0	No	No
Benzene (ug/L)	2023/01/03	<MDL 0.32	1.0	No	No
Benzo(a)pyrene (ug/L)	2023/01/03	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L)	2023/01/03	<MDL 0.33	5.0	No	No
Carbaryl (ug/L)	2023/01/03	<MDL 0.05	90.0	No	No
Carbofuran (ug/L)	2023/01/03	<MDL 0.01	90.0	No	No
Carbon Tetrachloride (ug/L)	2023/01/03	<MDL 0.17	2.0	No	No
Chlorpyrifos (ug/L)	2023/01/03	<MDL 0.02	90.0	No	No
Diazinon (ug/L)	2023/01/03	<MDL 0.02	20.0	No	No
Dicamba (ug/L)	2023/01/03	<MDL 0.2	120.0	No	No
1,2-Dichlorobenzene (ug/L)	2023/01/03	<MDL 0.41	200.0	No	No
1,4-Dichlorobenzene (ug/L)	2023/01/03	<MDL 0.36	5.0	No	No
1,2-Dichloroethane (ug/L)	2023/01/03	<MDL 0.35	5.0	No	No
1,1-Dichloroethylene (ug/L)	2023/01/03	<MDL 0.33	14.0	No	No
Dichloromethane (Methylene Chloride) (ug/L)	2023/01/03	<MDL 0.35	50.0	No	No
2,4-Dichlorophenol (ug/L)	2023/01/03	<MDL 0.15	900.0	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L)	2023/01/03	<MDL 0.19	100.0	No	No
Diclofop-methyl (ug/L)	2023/01/03	<MDL 0.4	9.0	No	No
Dimethoate (ug/L)	2023/01/03	<MDL 0.06	20.0	No	No
Diquat (ug/L)	2023/01/03	<MDL 1.0	70.0	No	No
Diuron (ug/L)	2023/01/03	<MDL 0.03	150.0	No	No
Glyphosate (ug/L)	2023/01/03	<MDL 1.0	280.0	No	No
Malathion (ug/L)	2023/01/03	<MDL 0.02	190.0	No	No
Metolachlor (ug/L)	2023/01/03	<MDL 0.01	50.0	No	No
Metribuzin (ug/L)	2023/01/03	<MDL 0.02	80.0	No	No
Monochlorobenzene (Chlorobenzene) (ug/L)	2023/01/03	<MDL 0.3	80.0	No	No
Paraquat (ug/L)	2023/01/03	<MDL 1.0	10.0	No	No
PCB (ug/L)	2023/01/03	<MDL 0.04	3.0	No	No
Pentachlorophenol (ug/L)	2023/01/03	<MDL 0.15	60.0	No	No
Phorate (ug/L)	2023/01/03	<MDL 0.01	2.0	No	No
Picloram (ug/L)	2023/01/03	<MDL 1.0	190.0	No	No

Southview Estates Drinking Water System – 2023 Annual Water Reports

Treated Water Parameter	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance MAC	Exceedance ½ MAC
Prometryne (ug/L)	2023/01/03	<MDL 0.03	1.0	No	No
Simazine (ug/L)	2023/01/03	<MDL 0.01	10.0	No	No
Terbufos (ug/L)	2023/01/03	<MDL 0.01	1.0	No	No
Tetrachloroethylene (ug/L)	2023/01/03	<MDL 0.35	10.0	No	No
2,3,4,6-Tetrachlorophenol (ug/L)	2023/01/03	<MDL 0.2	100.0	No	No
Triallate (ug/L)	2023/01/03	<MDL 0.01	230.0	No	No
Trichloroethylene (ug/L)	2023/01/03	<MDL 0.44	5.0	No	No
2,4,6-Trichlorophenol (ug/L)	2023/01/03	<MDL 0.25	5.0	No	No
2-methyl-4-chlorophenoxyacetic acid (MCPA) (ug/L)	2023/01/03	<MDL 0.12	100.0	No	No
Trifluralin (ug/L)	2023/01/03	<MDL 0.02	45.0	No	No
Vinyl Chloride (ug/L)	2023/01/03	<MDL 0.17	1.0	No	No
<b>Distribution Water</b>					
Trihalomethane: Total (ug/L) Annual Average	2023	96.6	100.0	No	Yes
HAA Total (ug/L) Annual Average	2023	59.6	80.0	No	Yes

MAC = Maximum Allowable Concentration as per O. Reg. 169/03  
 MDL = Method Detection Limit

**Additional Legislated Samples**

Municipal Drinking Water License	Location	No. of Samples Collected	Range of Results Minimum	Range of Results Maximum
Alkalinity (mg/L as CaCO <sub>3</sub> )	Point of Entrance to Distribution System	4	62.0	87.0
Aluminum (µg/L)	Point of Entrance to Distribution System	4	19.0	70.0
Dissolved Organic Carbon (mg/L)	Point of Entrance to Distribution System	54	2.0	6.0
Total Suspended Solids (mg/L)	Settling Tank Discharge Point	12	3.0	23.0

Municipal Drinking Water Licence	Collected Weekly June – Oct	Total Microcystin Raw Results Range (ug/L)	Total Microcystin Treated Water Results Range (ug/L)	Treated Water Total Microcystin Limit 1.5 ug/L Exceeded Y/N
Harmful Algal Blooms Monitoring required June to October at a minimum. Treated	June	<0.1 – <0.1	<0.1 - <0.1	N



<b>Municipal Drinking Water Licence</b>	<b>Collected Weekly June – Oct</b>	<b>Total Microcystin Raw Results Range (ug/L)</b>	<b>Total Microcystin Treated Water Results Range (ug/L)</b>	<b>Treated Water Total Microcystin Limit 1.5 ug/L Exceeded Y/N</b>
and Raw Water Samples collected weekly.	July	<0.1 - <0.1	<0.1 - <0.1	N
	August	<0.1 - <0.1	<0.1 - <0.1	N
	September	<0.1 - <0.1	<0.1 - <0.1	N
	October	<0.1 – <0.1	<0.1 - <0.1	N

**Major Maintenance Summary incurred to install, repair or replace required equipment**

<b>WO #</b>	<b>Description</b>
3288674	Backwash Pump BWK-325, Refurbishment
3525325	Carpenter Ants Removal, by Contractor
3571416	High Lift Pump 3, Motor Replacement
3625520	High Lift 3 Pump, Seal Packing Replacement
3665166	Filter 1 Valve Failure, Repair
3666569	SCADA Firmware Upgrade

# Appendix A

## WTRS Data and Submission Confirmation



Ministry of the Environment,  
Conservation and Parks

| [WT DATA](#) | [USER PROFILE](#) | [CONTACT US](#) | [HELP](#) | [HOME](#) | [LOGOUT](#) |

Location: [WTRS](#) / [WT DATA](#) / [Input WT Record](#)

WTRS-WT-008

**Water Taking Data submitted successfully.**

**Confirmation:**

Thank you for submitting your water taking data online.


Permit Number: 8118-AW2NZT  
Permit Holder: THE CORPORATION OF THE CITY OF KAWARTHA LAKES.  
Received on: Jan 16, 2024 3:11 PM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Print Confirmation](#)

[Return to Main Page](#)

CITY OF KAWARTHA LAKES | 2024/01/16  
version: v4.5.0.21 (build#: 22)  
Last modified: 2018/09/18



This site maintained by  
the Government of Ontario

©2024 [Queen's Printer for Ontario](#)