Appendix B
to
Report RS2024-029
File No. L25-24-RS011

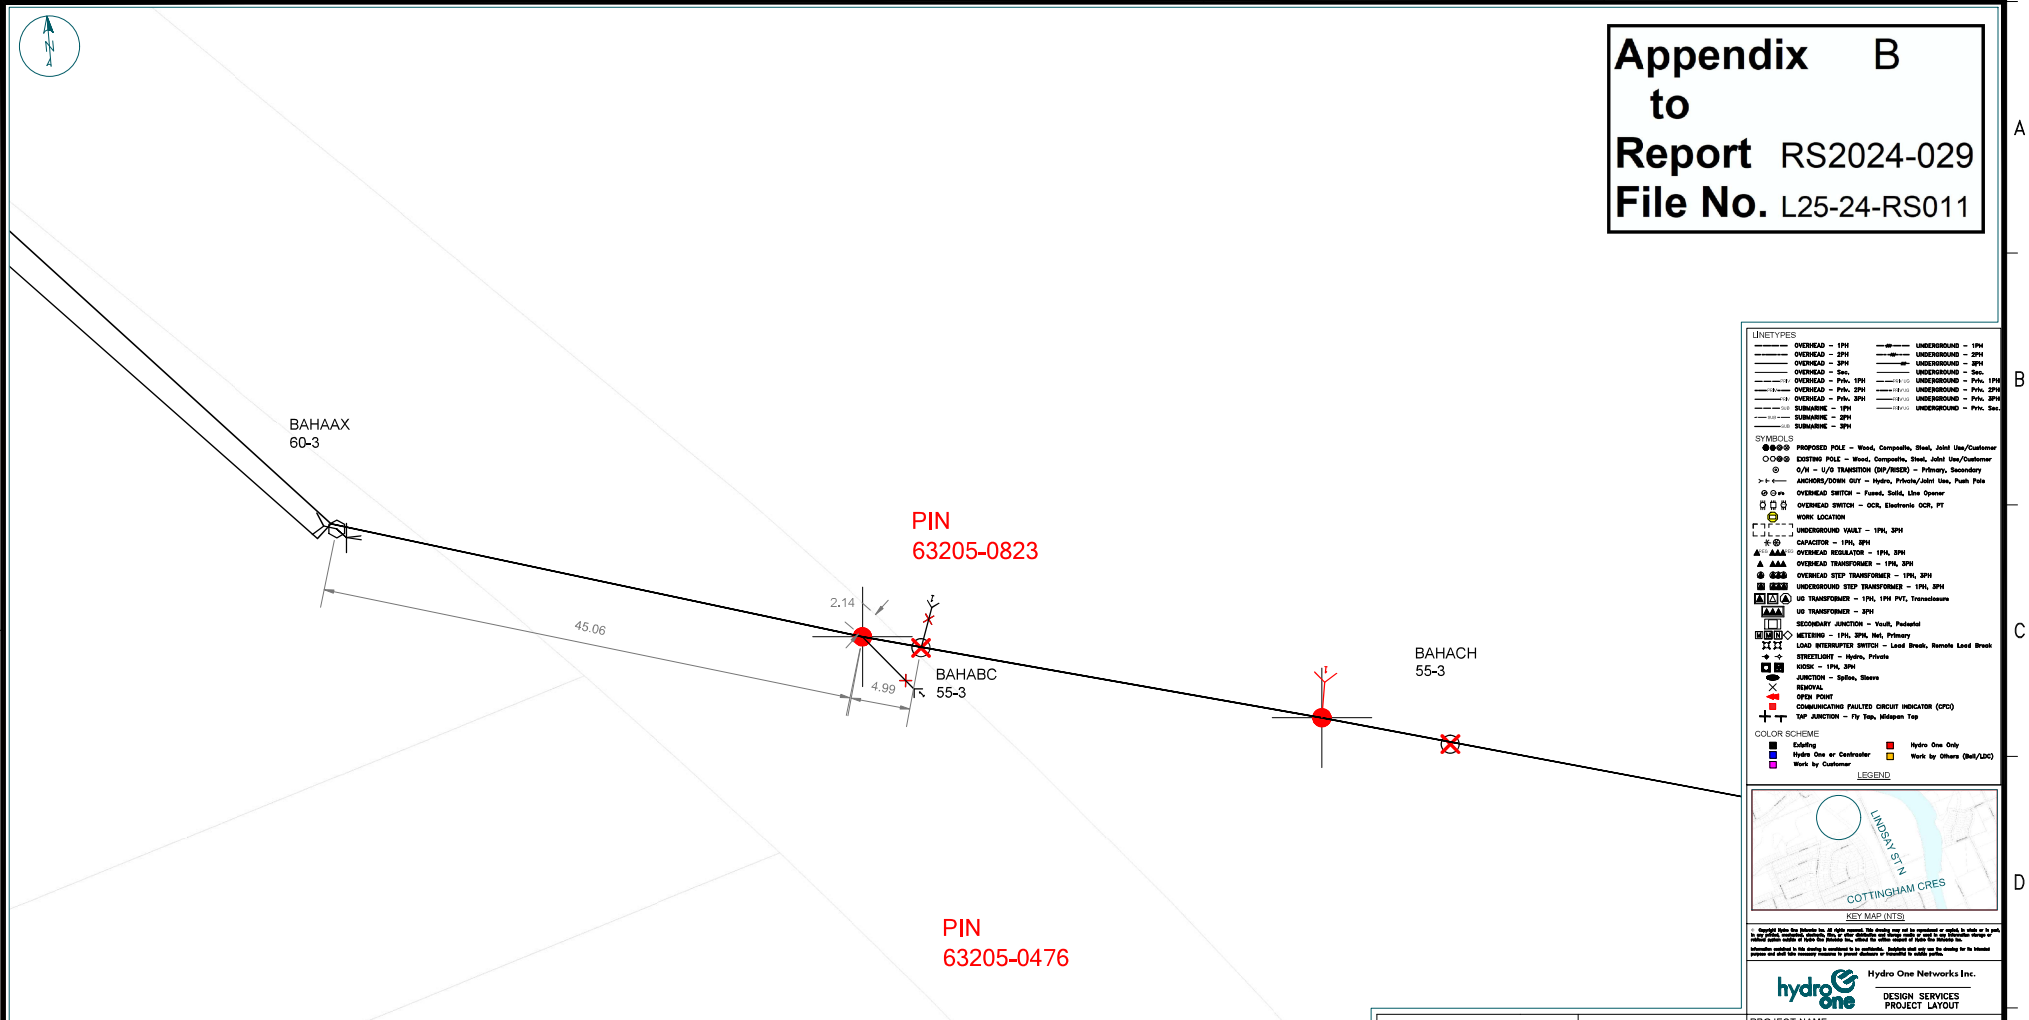

LINETYPES
OVERHEAD – 1PH
OVERHEAD – 2PH
OVERHEAD – 3PH
OVERHEAD – Sec.
OVERHEAD – Priv. 1PH
OVERHEAD – Priv. 2PH
OVERHEAD – Priv. 3PH
SUBMARINE – 1PH
SUBMARINE – 2PH
SUBMARINE – 3PH
UNDERGROUND – 1PH
UNDERGROUND – 2PH
UNDERGROUND – 3PH
UNDERGROUND – Sec.
UNDERGROUND – Priv. 1PH
UNDERGROUND – Priv. 2PH
UNDERGROUND – Priv. 3PH
UNDERGROUND – Priv. Sec.

SYMBOLS
PROPOSED POLE – Wood, Composite, Steel, Joint Use/Customer
EXISTING POLE – Wood, Composite, Steel, Joint Use/Customer
S/N – U/G TRANSITION (DIP/RISER) – Primary, Secondary
ANCHORS/DOWN GUY – Hydro, Private/Joint Use, Push Pole
OVERHEAD SWITCH – Fused, Solid, Line Opener
OVERHEAD SWITCH – OCR, Electronic OCR, PT
WORK LOCATION
UNDERGROUND VAULT – 1PH, 3PH
CAPACITOR – 1PH, 3PH
OVERHEAD REGULATOR – 1PH, 3PH
OVERHEAD TRANSFORMER – 1PH, 3PH
OVERHEAD STEP TRANSFORMER – 1PH, 3PH
UNDERGROUND STEP TRANSFORMER – 1PH, 3PH
UG TRANSFORMER – 1PH, 1PH PVT, Transclosure
UG TRANSFORMER – 3PH
SECONDARY JUNCTION – Vault, Pedestal
METERING – 1PH, 3PH, Net, Primary
LOAD INTERRUPTER SWITCH – Load Break, Remote Load Break
STREETLIGHT – Hydro, Private
NODE – 1PH, 3PH
JUNCTION – Spice, Sleeve
REMOVAL
OPEN POINT
COMMUNICATING FAULTED CIRCUIT INDICATOR (CFCI)
TAP JUNCTION – Fly Tap, Midspan Tap

COLOR SCHEME
Existing
Hydro One Only
Hydro One or Contractor
Work by Others (Bell/LDC)
Work by Customer

LEGEND

KEY MAP (NTS)

Copyright Hydro One Networks Inc. All rights reserved. This drawing may not be reproduced or copied, in whole or in part, in any printed, mechanical, electronic, film, or other distribution and storage media or used in any information storage or retrieval system without the prior written permission of Hydro One Networks Inc.
Information supplied on this drawing is considered to be authentic. Hydro One and use the drawing for its intended purpose and take necessary measures to prevent disclosure or misuse to outside parties.

Hydro One Networks Inc.
DESIGN SERVICES
PROJECT LAYOUT

PROJECT SUMMARY

ITEM	INSTALL	REMOVAL	MODIFY	NOTES
50' CLS WOOD POLE	1	1	0	0
40' CLS WOOD POLE	1	1	0	0

GENERAL NOTES
1. ALL DIMENSIONS ARE IN METERS UNLESS NOTED OTHERWISE.
2. IF TITLEBLOCK SCALE = CUSTOM, SCALE IS UNCOMMON AND CONSIDERED NOT TO SCALE.
3. CONTRACTOR PRE WORK, OFFROAD EQUIPMENT, LOCATES & EASEMENTS REQUIRED.

HAZARD IDENTIFICATION
1. XX
2. XX

PROJECT NAME :
220 LINDSAY ST N - 44KV RELOCATE

Additional Station/Feeder (if applicable) : ADDITIONAL STATION/FEEDER	Feeder Voltage (Primary) : FEEDER PRIMARY VOLTAGE
Additional Station/Feeder (if applicable) : ADDITIONAL STATION/FEEDER	Feeder Voltage (Primary) : FEEDER PRIMARY VOLTAGE
DS Station/Feeder : N-DL-LINDSAYTS-M3	Feeder Primary Voltage : 44 KV
Switch :	Township : Kawartha Lakes
Work Order Number : 64305728	Notification Number : 303443477
ADET : Olmstead, Wesley	Approver : DOWSWELL Troy / Scale : Custom
Prepared Date : 4/4/2024	Approver Date : 4/10/2024 / Page : X / X

Design ID : 657431

TITLE BLOCK REV 03 – MAY 2023

TABLOID (17"x11")

millimetres 0 10 50 100 150